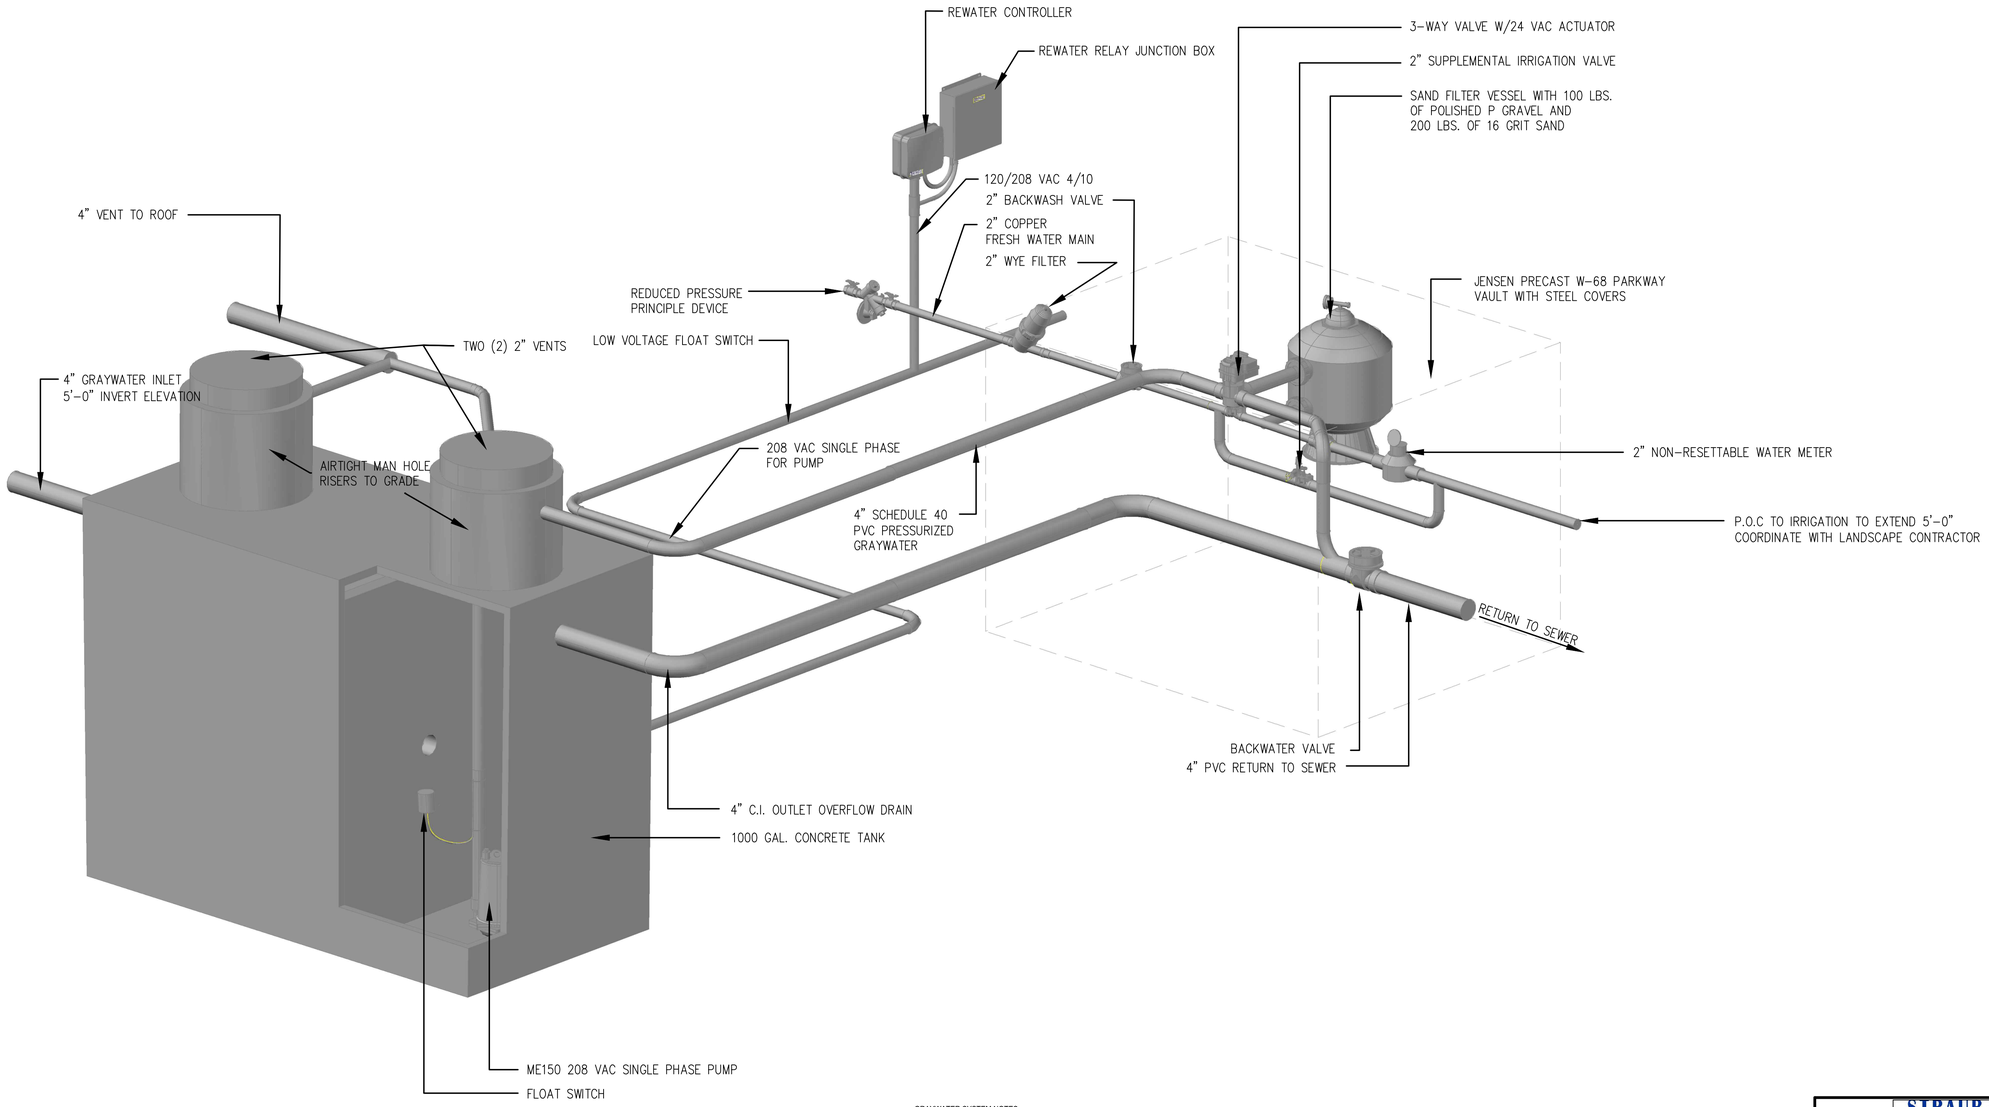

GRAYWATER SYSTEM NOTES:

1- THE INSTALLER OF THE GRAYWATER SYSTEM SHALL PROVIDE AN OPERATION AND MAINTENANCE MANUAL TO THE OWNER OF THE SYSTEM.

2- ALL GRAYWATER PIPING SHALL BE MARKED AS FOLLOWS: "DANGER -UNSAFE WATER".

3- THE CONTRACTOR SHALL INSTALL THE FOLLOWING LABEL ON THE SURGE TANK:

"GRAYWATER IRRIGATION SYSTEM, DANGER-UNSAFE WATER".

1 ENLARGED GRAYWATER FILTRATION SYSTEM BY REWATER

REVISIONS

SYMBOL	DESCRIPTION	DATE	APPROVED

SUBMITTED: PGAL
DESIGNED:
DRAWN:
CHECKED:
P.L.:
B.M.:
SATISFACTORY TO: DATE
APPROVED BY: DATE
D.M.:
DIR.:
F.P.:
SW DIV FOR COMMANDER NAVFAC

DEPARTMENT OF THE NAVY
NAVAL FACILITIES ENGINEERING COMMAND
SAN DIEGO
ENGINEERING FIELD DIVISION SOUTHWEST
CALIFORNIA

P-908 BEQ, P-909 BEQ, P-686 BEQ & POV PARKING STRUCTURE
MARINE CORPS AIR GROUND COMBAT CENTER
TWENTYNINE PALMS, CA
MARINE CORPS BASE

STRAUB - Martin-Harris A JOINT VENTURE

PGAL LLC.

REWATER SYSTEMS, INC.

PROJECT PHASE AND DATE
100% CONSTRUCTION DOCUMENTS
April 7, 2010

ISSUE FOR CONSTRUCTION

REWATER SYSTEMS, INC.
3362 JESSICA STREET
NEWBURY PARK, CA 91320

TEL: (805)262-2954

SUPPORT@REWATER.COM
WWW.REWATER.COM

SIZE D

IF SHEET SIZE IS LESS THAN 559 X 864 mm IT IS A REDUCED PRINT - SCALE REDUCED ACCORDINGLY

CODE INDENT. NO.

PROJECT LOCATION
TWENTYNINE PALMS

CONSTR. CONTR. NO.
N62473-09-C-1228

SPEC. NO.

NAVFAC DRAWING NO.

SHEET OF 792

RW-4